

K-No.: 26575

### 500A Current Sensor

For the electronic measurement of currents:  
DC, AC, pulsed, mixed with a galvanic Isolation  
between the primary circuit (high power) and the  
secondary circuit (electronic circuit)



Date: 22.05.2018

Customer: Standard type

Customers Part no:

Page 1 of 4

#### First articles for Production release

#### Remarks:

First articles have not been produced yet. In the course of the production and the inspection of first articles minor changes at the data sheet may arise.

#### Electrical data – Ratings

$I_{PN}$	Primary nominal RMS current	500	A
$R_M$	Measuring resistance	0 ... 200	$\Omega$
$I_{SN}$	Secondary nominal RMS current	250	mA
$K_N$	Transformation ratio	(1) : 2000	

#### Accuracy – Dynamic performance data

		min.	typ.	max.	Unit
$I_{P,max}$	Max. measuring range @ $V_C = \pm 15V$ , $R_M < 10\Omega$ ( $t_{max} = 10sec$ )	700			A
X	Accuracy @ $I_{PN}$ , $\vartheta_A = 25^\circ C$			0.5	%
$\epsilon_L$	Linearity			0.1	%
$I_O$	Offset current @ $I_P = 0A$ , $\vartheta_A = 25^\circ C$			0.2	mA
$t_r$	Response time		<1		$\mu s$
$t_{ra}$	Reaction time		<1		$\mu s$
f	Frequency bandwidth	DC...50			kHz

#### General data

$\vartheta_A$	Ambient operation temperature	-40		85	$^\circ C$
$\vartheta_S$	Ambient storage temperature (acc. M3101)	-40		85	$^\circ C$
m	Mass		120		g
$V_C$	Supply voltage	$\pm 14.25$	$\pm 15$	$\pm 15.75$	V
$I_C$	Supply current at $I_P = 0A$ and RT		$\pm 23$		mA

Constructed and manufactured and tested in accordance with IEC 61800-5-1:2007 (Pin 1-4 to hole)  
Reinforced insulation, Insulation material group 1, Pollution degree 2

$S_{clear}$	Clearance	8			mm
$S_{creep}$	Creepage	12			mm
$U_{sys,1}$	System voltage (overvoltage category III)			600	$V_{RMS}$
$U_{sys,2}$	System voltage (overvoltage category II)			1000	$V_{RMS}$
	max. Potential Difference acc. to UL 508			600	$V_{RMS}$

Date	Name	Issue	Amendment
		81	

Editor: R&D-PD NPI D

Designer: DJ

MC-PM: Sc.

Released: Pr.

K-No.: 26575

### 500A Current Sensor

For the electronic measurement of currents:  
DC, AC, pulsed, mixed with a galvanic Isolation  
between the primary circuit (high power) and the  
secondary circuit (electronic circuit)



Date: 22.05.2018

Customer: Standard type

Customers Part no:

Page 2 of 4

#### Mechanical outline (mm):


General tolerances DIN ISO 2768-c

Connections:

Pins 1-4: 0.64mm x 0.64mm

Marking:


UL-sign 4648-X052 F DC

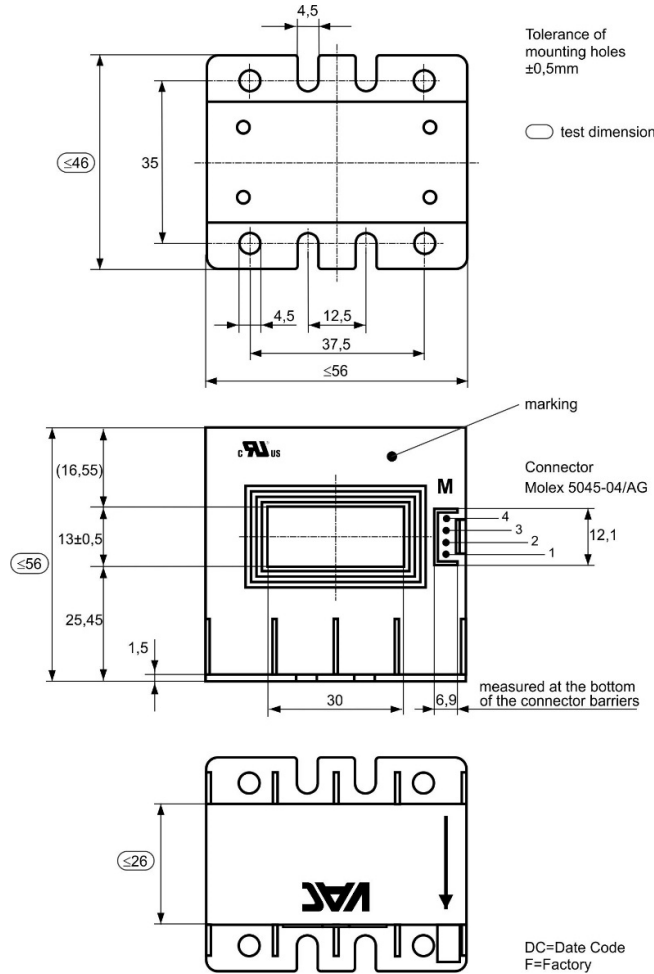

F: Factory  
DC: Date Code

Date Code Format: [YWW]  
Example: K04: 2018, Week 4

#### Schematic diagram:

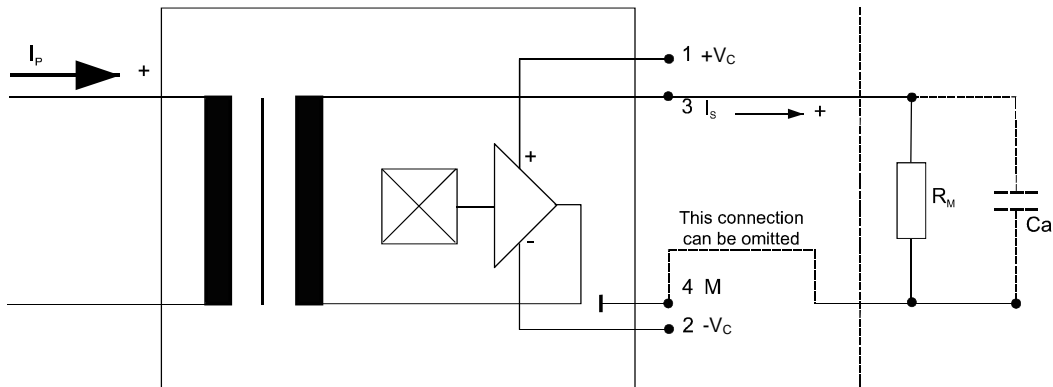

Editor: R&D-PD NPI D

Designer: DJ

MC-PM: Sc.

Released: Pr.

K-No.: 26575

### 500A Current Sensor

For the electronic measurement of currents:  
DC, AC, pulsed, mixed with a galvanic Isolation  
between the primary circuit (high power) and the  
secondary circuit (electronic circuit)



Date: 22.05.2018

Customer: Standard type

Customers Part no:

Page 3 of 4

**Electrical data:** (investigate by a type checking)

		min.	typ.	max.	Unit
$V_{C,tot}$	maximum supply voltage (without function) $\pm 15.75V$ to $\pm 18V$ : for 1s per hour			$\pm 18$	V
$R_S$	Secondary coil resistance @ $\vartheta_A = 85^\circ C$			30	$\Omega$
$X_{TI}$	Temperature drift of X @ $\vartheta_A = -40^\circ C \dots 85^\circ C$			0.1	%
$I_{ot}$	Long term drift of $I_o$		0.05		mA
$I_{oT}$	Offset current temperature drift $I_o$ @ $\vartheta_A = -40^\circ C \dots 85^\circ C$		0.05		mA
$I_{oH}$	Hysteresis current @ $I_p = 0A$ (caused by $I_p = 3 \times I_{PN}$ )		0.1		mA
$\Delta I_o / \Delta V_C$	Supply voltage rejection ratio			0.01	mA/V
$i_{oss}$	Offsetripple* (with 1 MHz-Filter, first order)		0.4	0.6	mA <sub>pp</sub>
$i_{oss}$	Offsetripple* (with 100 kHz-Filter, first order)		0.06		mA <sub>pp</sub>
$i_{oss}$	Offsetripple* (with 20 kHz-Filter, first order)		0.02		mA <sub>pp</sub>
$C_k$	Maximum possible coupling capacity (primary - secondary)		15		pF
	Mechanical stress according to M3209/3 Settings: 10-2000Hz, 1min/oct, 2 hours		2		g

**Routine Tests:** (Measurement after temperature balance of the samples at room temperature, SC=significant characteristic)

$K_N$ (SC)	(100%) M3011/6:	Transformation ratio		1990 ... 2010	
$I_o$	(100%) M3226:	Offset current		0.2	mA
$U_d$	(100%) M3014:	Test voltage, 1s		1.8	kV <sub>RMS</sub>
$U_{PDE}$	(AQL 1/S4) M3024:	Partial discharge voltage (extinction)		1.5	kV <sub>RMS</sub>
$U_{PD} * 1.875$				1.875	

**Type Tests:** (Precondition acc. to M3236)

$\hat{U}_W$	HV transient test acc. to M3064 (1.2 $\mu$ s / 50 $\mu$ s) 5 pules -> polarity +, 5 pulses -> polarity -		8		kV
$U_d$	Test voltage acc. to M3014, 5s		3.6		kV <sub>RMS</sub>
$U_{PDE}$	Partial discharge voltage (extinction) acc. to M3024		1.5		kV <sub>RMS</sub>
$U_{PD} * 1.875$			1.875		

Editor: R&D-PD NPI D

Designer: DJ

MC-PM: Sc.

Released: Pr.

K-No.: 26575

### 500A Current Sensor

For the electronic measurement of currents:  
DC, AC, pulsed, mixed with a galvanic Isolation  
between the primary circuit (high power) and the  
secondary circuit (electronic circuit)




Date: 22.05.2018

Customer: Standard type


Customers Part no:

Page 4 of 4

**Limit curve of measurable current of N4648-X052**

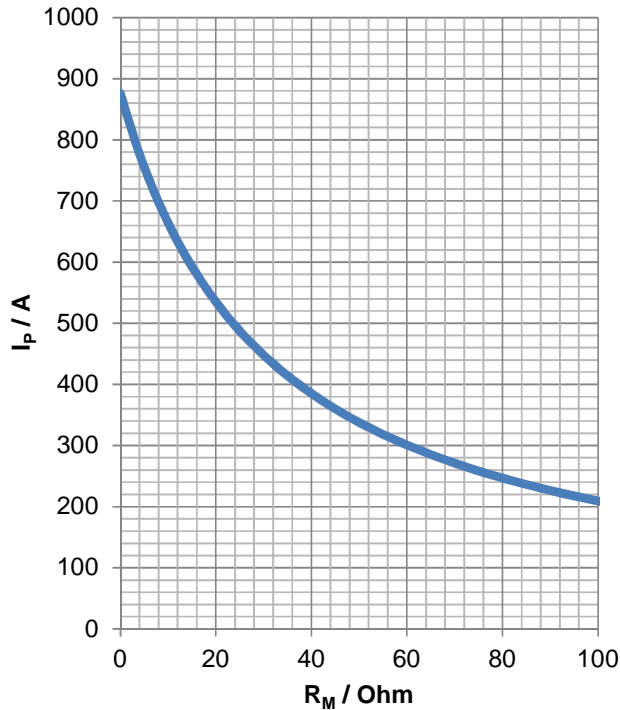

— Ip,max(15,0V-5%)

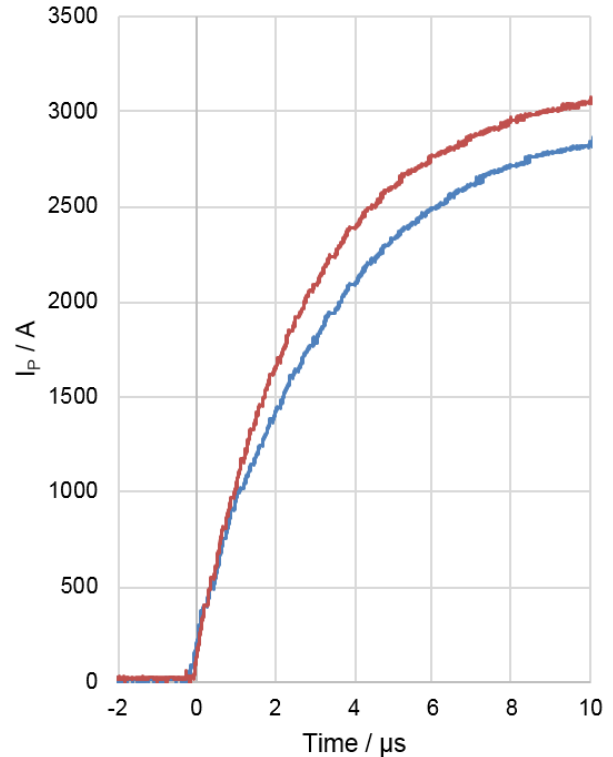

Fast increasing currents (higher than the specified  $I_{P,max}$ ), e.g. in case of a short circuit, can be transmitted because the currents are transformed directly and be limited by diodes only.

#### \*Possible way to reduce the Offset ripple by a Low-Pass-Filter

The offset ripple can be reduced by an external low pass. Simplest solution is a passive low pass filter of 1<sup>st</sup> order with cutoff frequency:

$$f_g = \frac{1}{2 * \pi * R_M * C_a}$$

In this case the response time is enlarged:

$$t'_r \leq t_r + 2,5 * R_M * C_a$$

#### Other instructions

- Current direction: A positive output current appears at point Is, if primary current flows in direction of the arrow.
- Temperature of the primary conductor should not exceed 105°C.
- Housing and bobbin material UL-listed: Flammability class 94V-0.
- Further standards: UL508, UL-file: E317483, category NMTR2 / NMTR8

Editor: R&D-PD NPI D

Designer: DJ

MC-PM: Sc.

Released: Pr.